Hazardous voltage. Will cause death or serious injury. Turn off and lock out all power supplying this device before working on this device.
Installation and maintenance must be carried out by qualified personnel.

Assembly

Notice: This device must be installed on a flat surface or other structure providing a flat base to prevent warping of the device. Warping will impact the functionality of the connections between the front and rear part of the device.

Make sure there is sufficient space for airflow above and below the device.

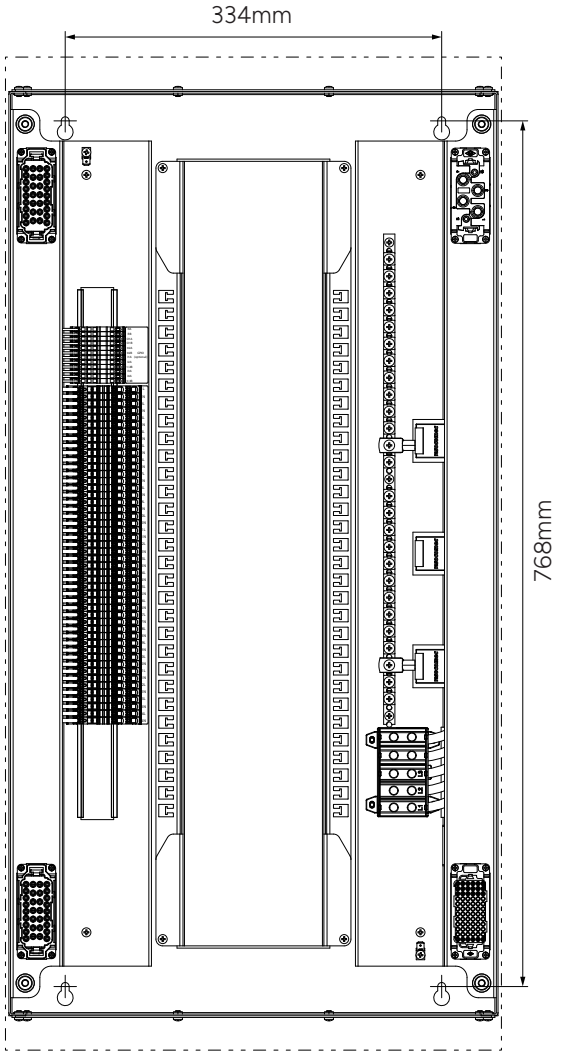

1 2 3
Top, bottom & rear plates can be removed and adapted to fit to the installtion requriements

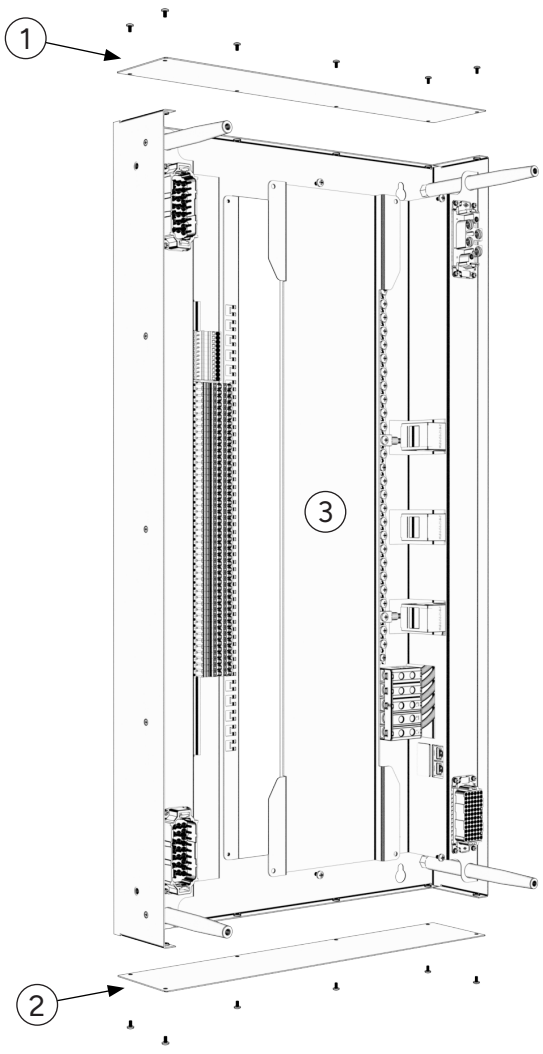

Hazardous voltage. Will cause death or serious injury. Turn off and lock out all power supplying this device before working on this device.
Installation and maintenance must be carried out by qualified personnel.

Connections

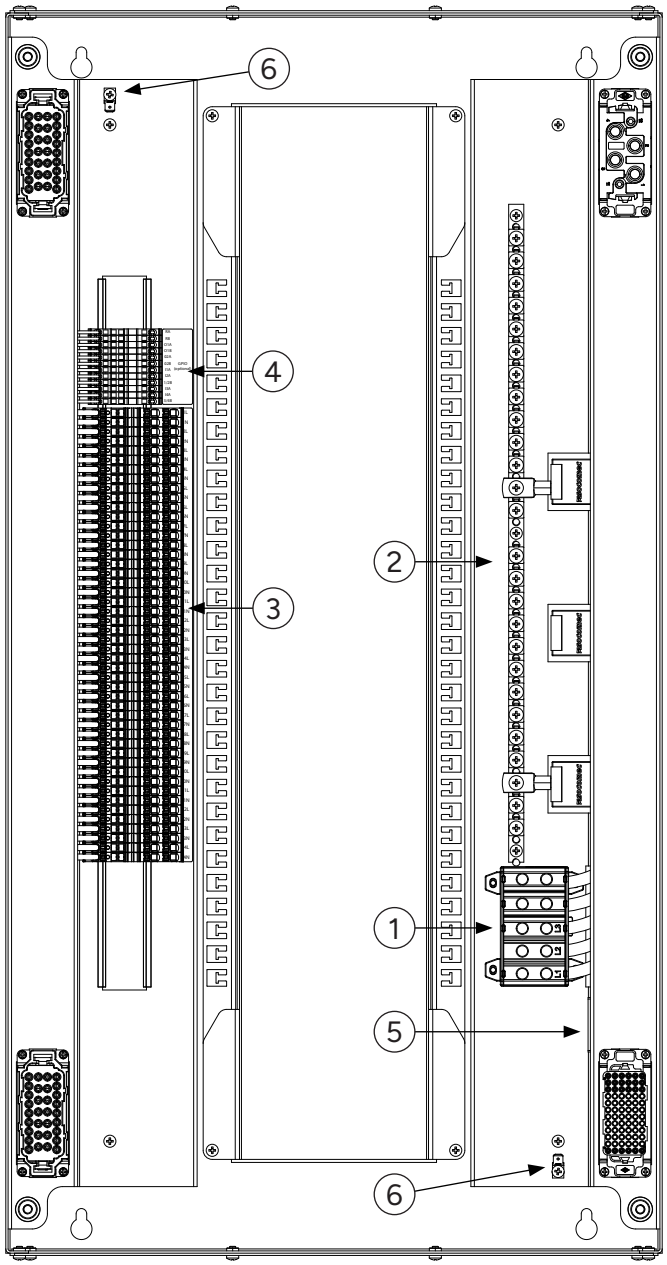

4
GPIO
Quick connection
(1.5mm²)

3
Output 1-24 (L, N)
Quick connection
Dual parallel (4mm²)

6
PE
FASTON terminal
(6.3x0.8mm)

2
PE
2.5 Nm

1
Mains input L1, L2, L3, N, PE
3 Nm (2,5-16mm²)
6 Nm (25-35mm²)

5
Ethernet
2 x RJ45

Notice: These instructions do not purport to cover all details or variations in equipment, or to provide for every possible contingency in connection with installation, operation, or maintenance. Should additional information be desired, please contact Stage Smarts support.